


# Florida Building Code

## Wood Fences

**Sec. 1615 Fences.** Fences not exceeding 6'-0" in height from grade may be designed for 75 mph (33 m/s) fastest wind speed or 115 mph (40 m/s) 3-second gust.

**Sec. 1615 Wood Fences.** Wood fence design shall be as specified by 2328.

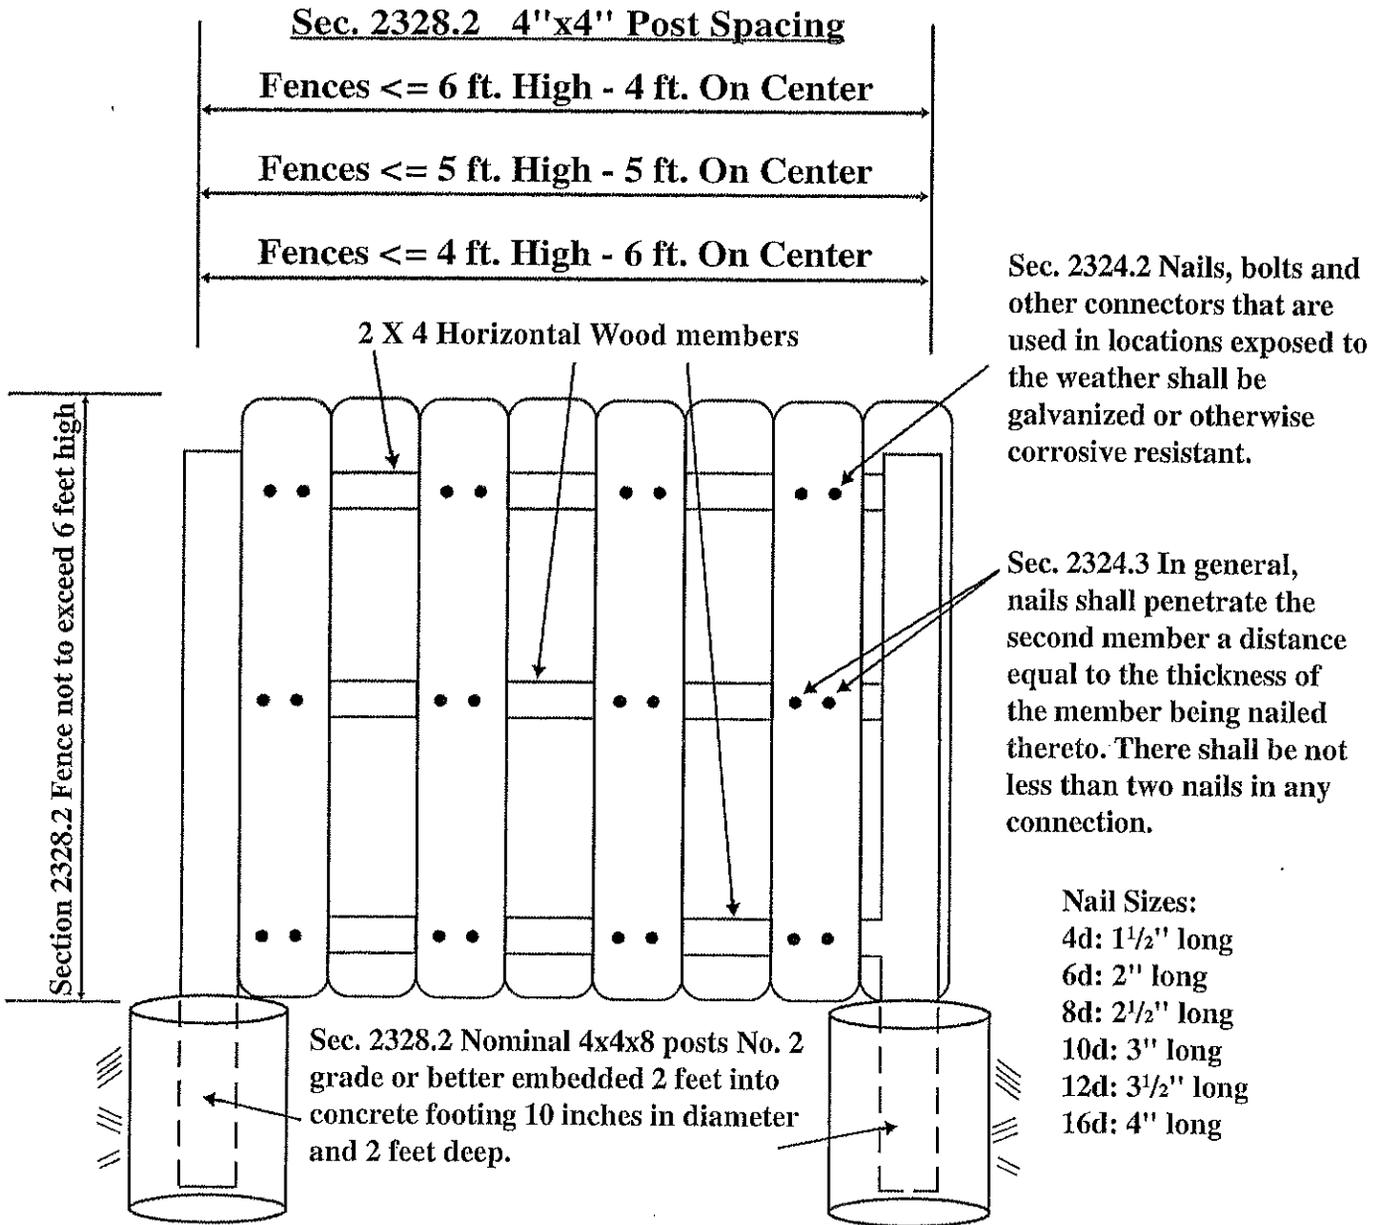

# FINAL INSPECTION

To be made after installation and completion of all elements of construction

**The following items will be checked at final inspection.**

Wood fences shall be designed according to the loads as specified in Section 1615 of Florida Building Code (F.B.C.).

**EXCEPTION:** Unless designed by rational analysis, wood fences not exceeding 6' in height may be constructed to meet the following minimum requirements.

1. Vertical post of P.T. 4"x4" spaced according to detail "A" below.
2. Post shall be embedded 2'0" or 24" into a concrete footing 10" in diameter.
3. Horizontal framing shall consist of a minimum of 3 horizontal rails of 2"x4" P.T. material and shall be fastened with 2-16D nails at each post.
4. All lumber shall be a minimum of #2 grade or better.
5. All fasteners shall be corrosion resistant.

**WARNING:** Premanufactured sections may not comply with this code.

Product Approval may be required.

## City Code Section 5.36(f):

Fences or walls shall be constructed of masonry materials, wood, chain link, P.V.C. or other materials approved by the building code. **The decorative side of wall or fence shall face the exterior or public side.**

