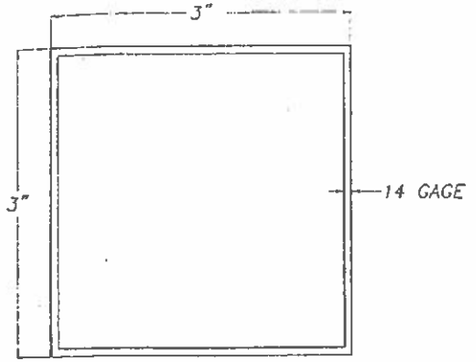

Ⓐ **POST**

ASTM A 653 SQ GRADE 40 DESIGNATION STEEL W/ G-90 (Min.) GALVANIZING.

SCALE : 3/4"=1"



Ⓑ **TOP/BOTTOM RAILS**

ASTM A 653 SQ GRADE 40 DESIGNATION STEEL W/ G-90 (Min.) GALVANIZING.

SCALE : 3/4"=1"



Ⓒ **PICKET**

ASTM A 653 SQ GRADE 40 DESIGNATION STEEL W/ G-90 (Min.) GALVANIZING.

SCALE : 3/4"=1"

GENERAL NOTES:

1. THIS FENCE HAS BEEN DESIGNED IN ACCORDANCE WITH THE 2017 FLORIDA BUILDING CODE.
2. THIS FENCE MAY BE INSTALLED WITHIN EXPOSURE C ZONES, AS DEVINED BY ASCE7-10 WIND CODE
3. ALL ALLOYS AND MATERIAL SPECIFICATIONS FOR FENCE COMPONENTS SHALL BE AS SPECIFIED ON SHEET 1 OF 2 OF THIS DRAWING.
4. ALL WELDING TO BE PERFORMED IN ACCORDANCE WITH THE AMERICAN WELDING SOCIETY LATEST EDITION REGULATIONS. USED CERTIFIED WELDERS. USE 3-70 ELECTRODES.
5. ALL CRONCRETE TO DEVELOP f'c = 3000 psi AT 28 DAYS AND TO BE CONSTRUCTED IN ACCORDANCE WITH THE ACI 318-08 CODE SPECIFICATIONS.
6. MINIMUM SOIL BEARING CAPACITY REQUIRED IS 2000 psf. NOTIFY THIS ENGINEER SHALL SOIL CONDITIONS DIFFER FROM ABOVE MENTIONED.
7. LOCATION USE AND CONSTRUCTION OF THIS FENCE SHALL COMPLY WITH ALL APPPLICABLE ZONING REGULATIONS.
8. CONTRACTOR TO VERIFY ALL DIMENSIONS AT SITE BEFORE PROCEEDING WITH THE WORK, AND SHALL NOTIFY THIS ENGINEER IF ANY CHANGES OR DISCREPANCIES BE FOUND. HE SHOULD COORDINATE AND VERIFY THE EXISTENCE OF ANY UTILITIES THAT MAY INTEFERE WITH THE CONSTRUCTION OF THIS JOB AND SHALL NOTIFY THIS ENGINEER SHOULD ANY ALTERATION BE REQUIRED BEFORE PROCEEDING WITH THE WORK.
9. FENCE FINISH TO BE PAINTED ENAMEL. COLOR TO BE COORDINATED BETWEEN MANUFACTURER AND OWNER.

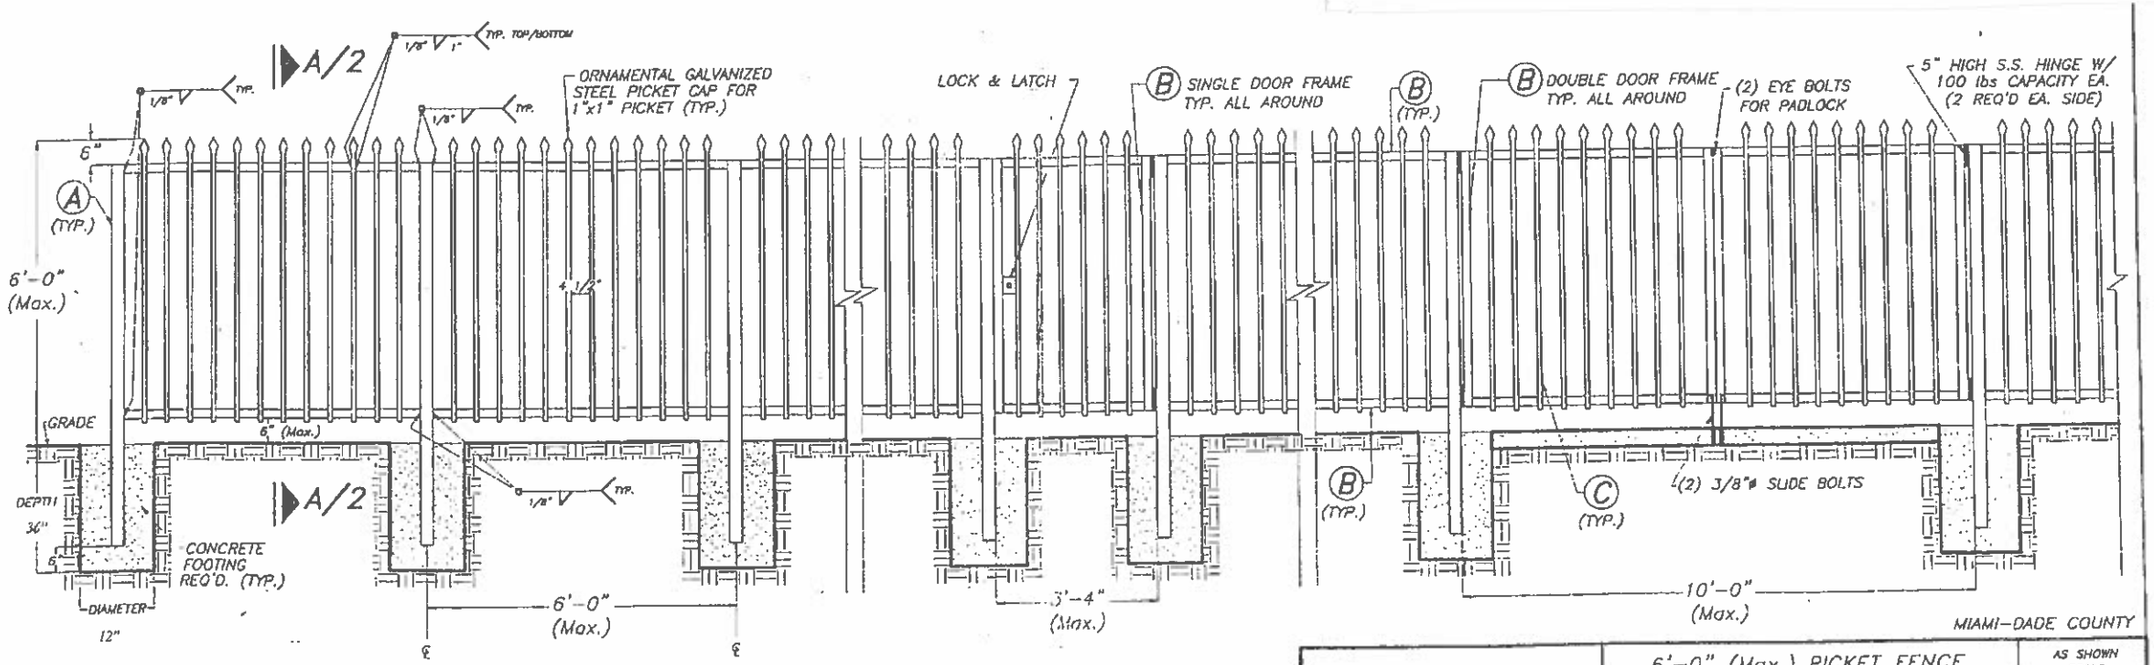

TYPICAL ELEVATION

SCALE: 3/8"=1'-0"

6'-0" (Max.) PICKET FENCE

AS SHOWN SCALE

City of North Miami Beach, Florida

BUILDING DEPARTMENT

12/6/99 DATE

99 - 368 DRAWING No

KEY. No.	DESCRIPTION	DATE	KEY. No.	DESCRIPTION	DATE
1	-	-	3	-	-
2	-	-	4	-	-

SHEET 1 OF 2