




City of North Miami Beach, Florida

BUILDING DIVISION

Electrical Requirements For Kitchen Cabinet Replacement

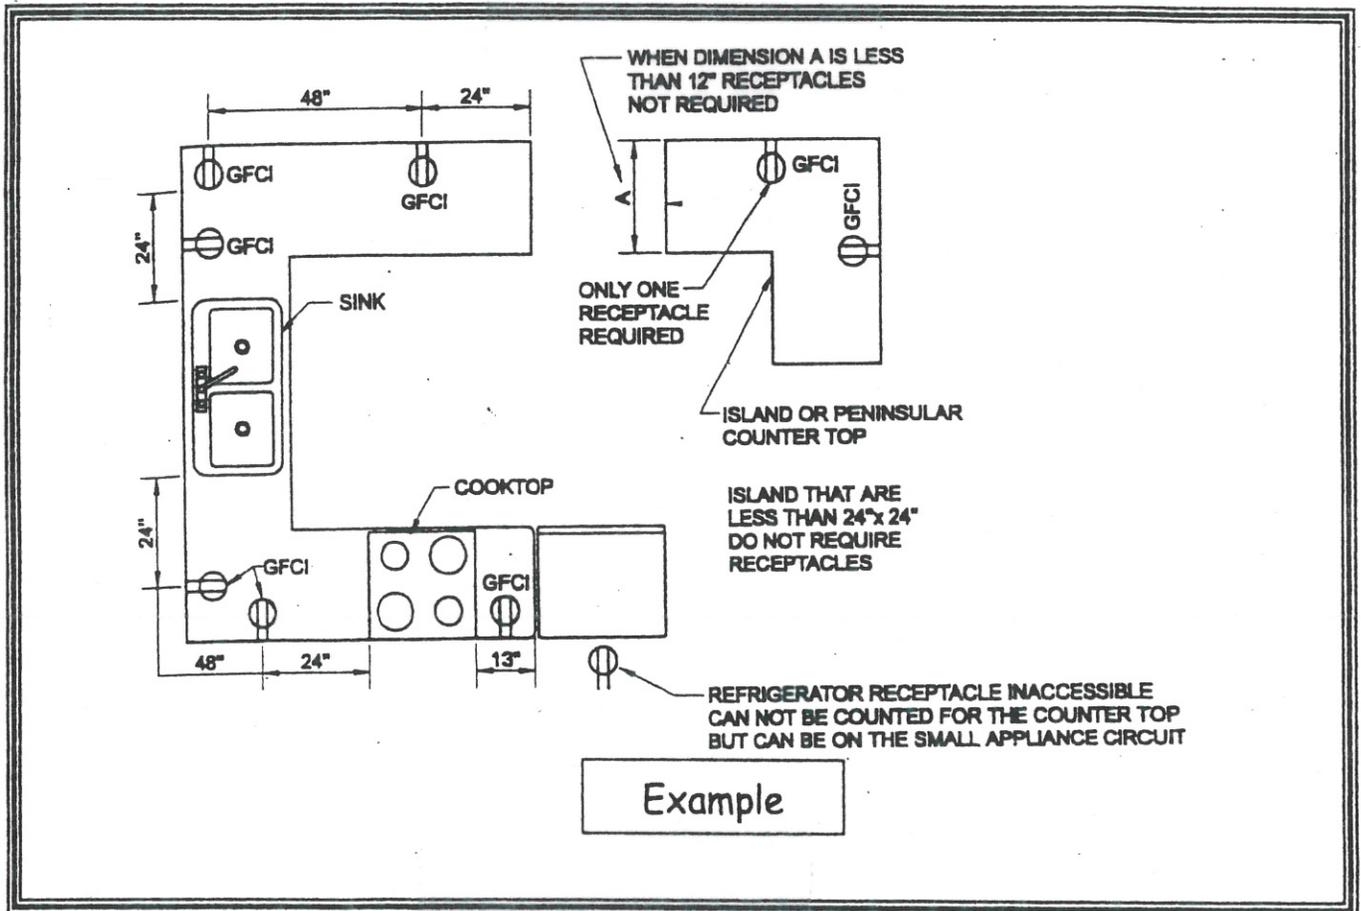

APPLICATION FOR REPLACEMENT OF KITCHEN CABINETS SHALL INCLUDE THE FOLLOWING:

1. Two drawings showing kitchen cabinet layout, including measurements as shown in diagram.
2. Indicate all existing and new receptacles including circuit number and amperage.
3. Rough and Final inspections will be required for Electrical Permit.
4. Kitchens are required to have two small appliance 20 amp circuits for counter top GFI protected receptacles. 210.11 (C) (1) & 210.52
5. Refrigerators, dishwashers, disposals, microwaves and other appliances normally are required to have individual branch circuit 20 amp or larger.
6. Applications must contain names and addresses of contractor & owner / tenant with notarized signature of electrical qualifier.
7. F.B.C. R313.2.1 Requires 120 volt interconnected hard wired smoke alarms be installed inside and outside bedroom doors per NFPA 72 whenever interior renovations are permitted for construction.



City of North Miami Beach, Florida

BUILDING DIVISION

Electrical Requirements For Bathroom Renovations & Upgrades

APPLICATION FOR REPLACEMENT OF RESIDENTIAL BATHROOM CABINETS OR UPGRADES SHALL INCLUDE THE FOLLOWING:

- 1 Two drawings showing bathroom layout required.
- 2 Indicate existing or new GFI receptacles including circuit number and amperage.
- 3 Rough and Final inspections will be required for Electrical Permit.
- 4 Bathrooms are required to have a 20 amp circuit for GFI protected receptacles. Each vanity sink is required to have one GFI protected receptacle adjacent to it. Lighting and exhaust fans may be on same 20 amp or different 15 amp circuit.
- 5 Jacuzzi and spa tubs must be on dedicated minimum 20 amp GFI protected cir.
- 6 Applications must contain names and addresses of contractor & owner / tenant with notarized signature of electrical qualifier.
- 7 F.B.C. R313.2.1 Requires 120 volt interconnected hard wired smoke alarms be installed inside and outside bedroom doors per NFPA 72 whenever interior renovations are permitted for construction.